



De Rust Grass Carp Coulter Counter Test Results


DATE	20-08-2011
BATCH NR	2010 D
NR OF FISH	10
PLOIDY	Diploid

OPERATOR
F.A. Claassen

NR	FILE NR	SAMPLE NR	PARTICLES	MODE (fl)
1	2011d01	14340	1786	11.44
2	2011d02	14341	2711	11.44
3	2011d03	14342	2062	11.44
4	2011d04	14343	1553	12.23
5	2011d05	14344	2273	11.96
6	2011d06	14347	2917	10.65
7	2011d07	14348	1500	11.44
8	2011d08	14350	1370	12.23
9	2011d09	14354	1737	10.65
10	2011d10	14358	2267	10.13

BATCH AVERAGE(fl)	11.361
-------------------	--------

CAPE NATURE OFFICER	Corne Claassen
---------------------	----------------

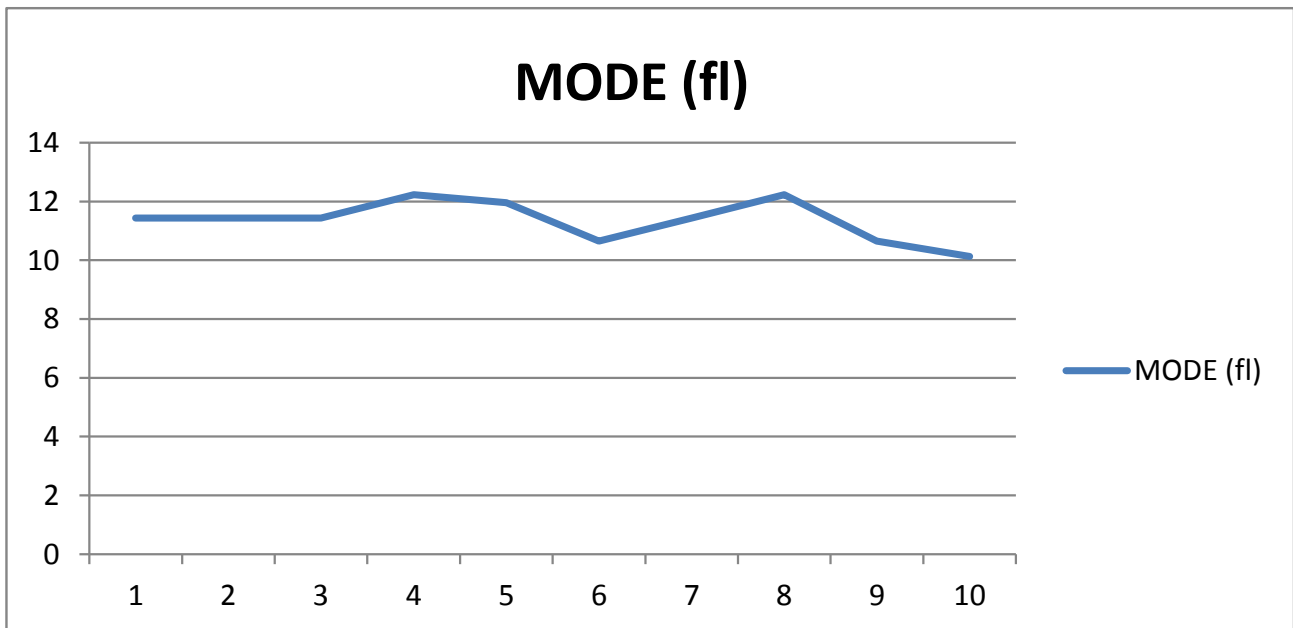



De Rust Grass Carp Coulter Counter Test Results


DATE	20-08-2011
BATCH NR	2010T1
NR OF FISH	650
PLOIDY	Triploid

OPERATOR F.A. Claassen

NR	FILE NR	SAMPLE NR	PARTICLES	MODE (fl)
1	2011t01	14359	1583	16.7
2	2011t02	14360	2322	16.17
3	2011t03	14361	1432	16.7
4	2011t04	14362	1166	16.7
5	2011t05	14363	2637	16.7
6	2011t06	14364	884	16.17
7	2011t07	14365	2256	15.91
8	2011t08	14366	940	17.75
9	2011t09	14367	1119	16.7
10	2011t10	14369	1922	17.49
11	2011t11	14370	1154	17.75
12	2011t12	14371	13702	15.65
13	2011t13	14372	1058	16.96
14	2011t14	14374	1044	16.7
15	2011t15	14375	1578	16.96
16	2011t16	14376	1502	17.22
17	2011t17	14378	1967	18.81
18	2011t18	14379	1888	16.7
19	2011t19	14380	1609	16.17
20	2011t20	14381	2448	16.17

BATCH AVERAGE(fl)	16.804
--------------------------	--------

CAPE NATURE OFFICER	Corne Claassen
----------------------------	----------------

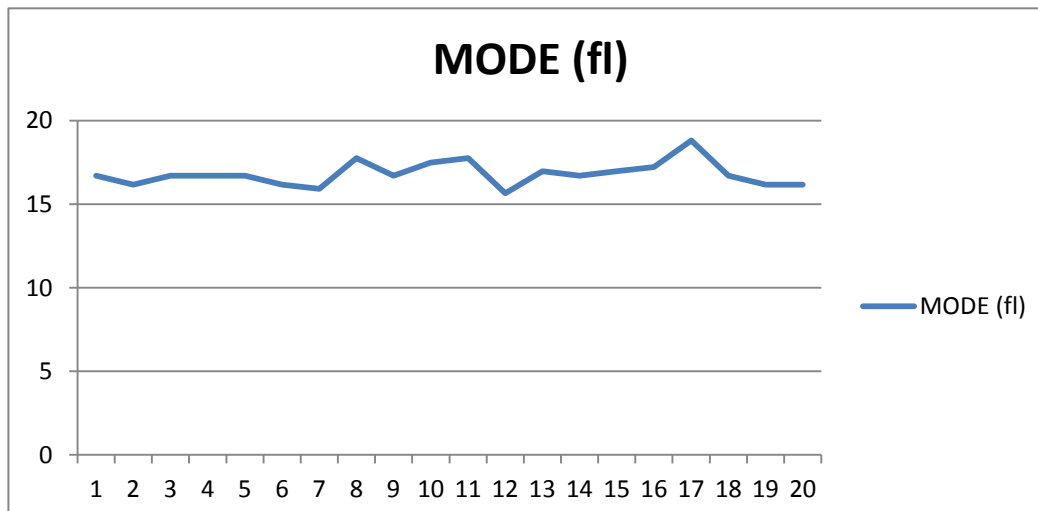



De Rust Grass Carp Coulter Counter Test Results


DATE	
BATCH NR	2011t2
NR OF FISH	3500
PLOIDY	Triploid

OPERATOR F.A. Claassen

NR	FILE NR	SAMPLE NR	PARTICLES	MODE (fl)
1	2011t21	14383	929	17.75
2	2011t22	14384	1975	17.22
3	2011t23	14385	1589	16.96
4	2011t24	14386	1345	15.65
5	2011t25	14387	3104	15.65
6	2011t26	14388	1500	16.17
7	2011t27	14389	3805	17.22
8	2011t28	14390	3372	18.28
9	2011t29	14391	1377	16.7
10	2011t30	14392	2895	17.22
11	2011t31	14393	1133	18.81
12	2011t32	14394	2113	18.28
13	2011t33	14395	4748	21.7
14	2011t34	14397	9296	19.33
15	2011t35	14398	8802	16.17
16	2011t36	14400	2716	19.86
17	2011t37	14401	1811	16.96
18	2011t38	14402	3851	16.96
19	2011t39	14403	9949	17.22
20	2011t40	14404	3775	20.12

BATCH AVERAGE	17.7115
---------------	---------

CAPE NATURE OFFICER	Corne Claassen
---------------------	----------------

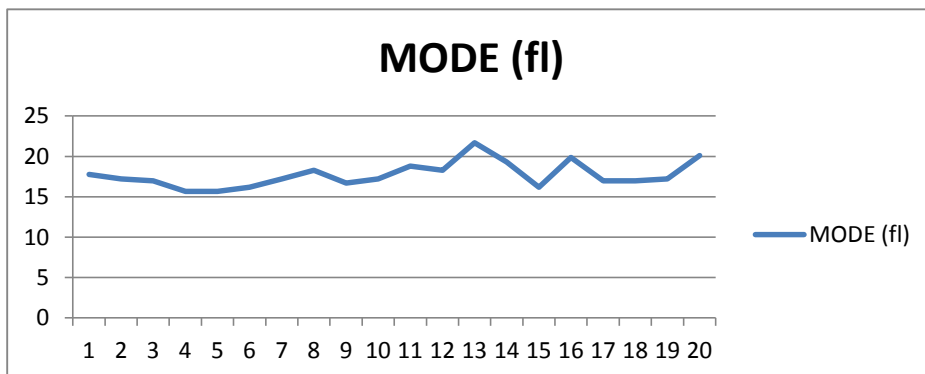

DE RUST COMPOUNDED GRAPHS

Diploid Control	Batch 2010T1	Batch 2010T2
11.44	16.7	17.75
11.44	16.17	17.22
11.44	16.7	16.96
12.23	16.7	15.65
11.96	16.7	15.65
10.65	16.17	16.17
11.44	15.91	17.22
12.23	17.75	18.28
10.65	16.7	16.7
10.13	17.49	17.22
	17.75	18.81
	15.65	18.28
	16.96	21.7
	16.7	19.33
	16.96	16.17
	17.22	19.86
	18.81	16.96
	16.7	16.96
	16.17	17.22
	16.17	20.12

